



**SIRIM QAS International Sdn. Bhd.**

No. 1, Persiaran Dato' Menteri, P.O.Box 7035, Seksyen 2, 40700 Shah Alam, Selangor Darul Ehsan  
MALAYSIA

Tel: 03-55446465

Fax: 03-55446454

http://www.sirim.my

(Company No: 410334-X)

## TEST REPORT

REPORT NO.: 2012FE0124

PAGE 1 OF 3

This Test Report refers only to samples submitted by the applicant to SIRIM QAS International Sdn. Bhd. and tested by SIRIM QAS International Sdn. Bhd. This Test Report shall not be reproduced, except in full and shall not be used for advertising purposes by any means or forms without written approval from Managing Director of SIRIM QAS International Sdn. Bhd. Please refer overleaf for conditions to the use of Test Report.

Applicant/  
Manufacturer : **CSC STEEL SDN. BHD.**  
180, Kawasan Industri Ayer Keroh,  
75450 Ayer Keroh,  
Melaka.  
(Attn: Mr. Lew Ren Shang)

Product : **GALVANIZED IRON SHEET SGC570 Z18 1.00MM (BMT)**

Reference Standard/ : **BS 476 : Part 7: 1997**  
Method of Test : **Fire Test on Building Materials and Structures**  
**Part 7: Surface Spread of Flame Test.**

Description of Test : **6 pieces of Galvanized Iron Sheet SGC570 Z18 1.00mm (BMT).**  
Specimen  
Size of Specimen : **270mm × 885mm × 1.04 mm (measured thickness)**  
Nominal Thickness : **1.0 mm**  
Measured Density : **7790 kg/m<sup>3</sup>**

The specimens were tested with the face side exposed to the specified heating condition of the fire test.


Date Received : 19.03.2012


Date of Test : 04.04.2012


Job No./ Ref No. : J20121280095 /SQAS/FPS/15/1-6

Test Result : **Classification of Surface Spread of Flame Test** : **Class 1**

Issued Date : **19 APR 2012**

  
.....  
**HANAFI MOHAMAD**  
Senior Testing Executive



  
.....  
**ZAINI AHMAD**  
Group Leader  
Fire Protection Section  
Testing Services Department  
SIRIM QAS International Sdn. Bhd

## TEST REPORT

REPORT NO.: 2012FE0124

PAGE 2 OF 3

This Test Report refers only to samples submitted by the applicant to SIRIM QAS International Sdn. Bhd. and tested by SIRIM QAS International Sdn. Bhd. This Test Report shall not be reproduced, except in full and shall not be used for advertising purposes by any means or forms without written approval from Managing Director of SIRIM QAS International Sdn. Bhd.

Name of Applicant : CSC STEEL SDN. BHD.  
Product : GALVANIZED IRON SHEET SGC570 Z18 1.00MM (BMT)  
Nominal Thickness : 1.0 mm  
Measured Thickness : 1.04 mm  
Measured Density : 7790 kg/m<sup>3</sup>  
Date of Test : 04.04.2012

### Requirement

The flame spread on any specimen of the sample shall not exceed the limit assigned for the class with the proviso that for one specimen only in the sample the flame spread may exceed this limit by the tolerance shown.

### Classification of Surface Spread of Flame

Classification	Flame Spread at 1½ min		Final Flame Spread	
	Limit (mm)	Tolerance for one specimen in sample (mm)	Limit (mm)	Tolerance for one specimen in sample (mm)
Class 1	165	25	165	25
Class 2	215	25	455	45
Class 3	265	25	710	75
Class 4	Exceeding Class		3 limits	



19 APR 2012

## TEST REPORT

**REPORT NO.:** 2012FE0124

**PAGE 3 OF 3**

This Test Report refers only to samples submitted by the applicant to SIRIM QAS International Sdn. Bhd. and tested by SIRIM QAS International Sdn. Bhd. This Test Report shall not be reproduced, except in full and shall not be used for advertising purposes by any means or forms without written approval from Managing Director of SIRIM QAS International Sdn. Bhd.

### Test Results


**Product** : GALVANIZED IRON SHEET SGC570 Z18 1.00MM (BMT)  
**Nominal Thickness** : 1.0 mm                      **Measured Density** : 7790 kg/m<sup>3</sup>  
**Measured Thickness** : 1.04 mm                      **Date of Test** : 04.04.2012

Specimen No.	1	2	3	4	5	6
Spread of flame at 1½ minutes (mm)	0	0	0	0	0	0
Distance (mm)	Time of spread of flame to indicated distance ( minutes . seconds )					
75	-	-	-	-	-	-
165	-	-	-	-	-	-
190	-	-	-	-	-	-
215	-	-	-	-	-	-
240	-	-	-	-	-	-
265	-	-	-	-	-	-
290	-	-	-	-	-	-
375	-	-	-	-	-	-
455	-	-	-	-	-	-
500	-	-	-	-	-	-
525	-	-	-	-	-	-
600	-	-	-	-	-	-
675	-	-	-	-	-	-
710	-	-	-	-	-	-
750	-	-	-	-	-	-
785	-	-	-	-	-	-
825	-	-	-	-	-	-
865	-	-	-	-	-	-
Time of maximum spread of flame (minutes . seconds)	-	-	-	-	-	-
Distance of maximum spread of flame (mm)	0	0	0	0	0	0

### Conclusion

In accordance with the class definition specified in the standard, the test results show that the sample tested has a Class **One** Surface Spread of Flame.

The test results relate only to the behavior of the test specimens of a product under the particular conditions of test. They are not intended to be sole criterion for assessing the potential fire hazard of the product in use.

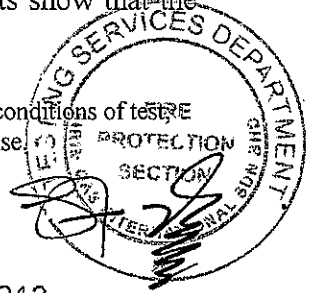

19 APR 2012